


# 1000 GALLON HAZARDOUS CHEMICAL AND FUEL CONTAINMENT VESSEL




**NOTES:**

1. MINIMUM COMPRESSIVE STRENGTH TO BE 4000 PSI.
2. REINFORCEMENTS TO BE #4 REBAR ON 12 INCH CENTERS IN FLOORS AND WALLS.

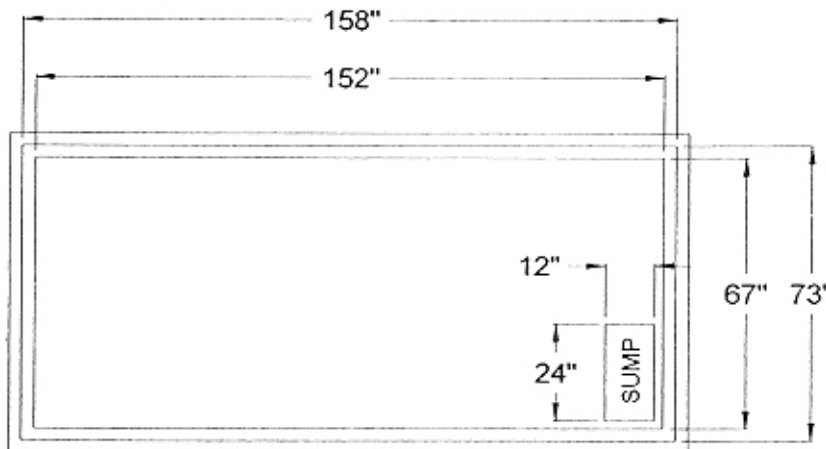

2" DEEP SUMP  
SIPHON ARRANGEMENT  
PROVIDED FOR THE REMOVAL  
OF RAIN WATER AND SPILLED  
PETROLEUM PRODUCTS

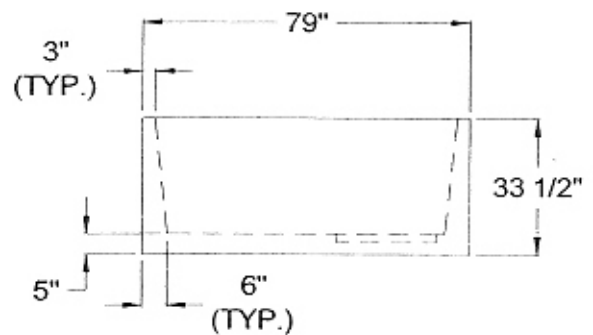

SHEET 2 OF 2

GROVE CONCRETE & SUPPLY, INC.  
18426 DURAND AVENUE P.O. BOX 363  
UNION GROVE, WISCONSIN 53182  
(262) 878-2030

**1000 GALLON TANK  
CONTAINMENT VESSEL**

DRAWN: **Dx**      DATE: **01/04/02**

SCALE: **NTS**

DWS. NUMBER: **CON-1000**

THIS DRAWING AND THE INFORMATION CONTAINED HEREON IS THE EXCLUSIVE PROPERTY OF GROVE CONCRETE & SUPPLY, INC., AND SHALL NOT BE REPRODUCED, USED, OR DISCLOSED TO OTHERS EXCEPT AS AUTHORIZED THROUGH WRITTEN CONCENT FROM GROVE CONCRETE & SUPPLY, INC.